



**TEST REPORT**  
**IEC 60598-2-2**  
**Luminaires**  
**Part 2: Particular requirements**  
**Section 2: Recessed luminaires**

<b>Report Number.....:</b>	<b>BCTC-FY170906580S</b>
<b>Date of issue.....:</b>	<b>Sep. 29, 2017</b>
<b>Total number of pages.....</b>	<b>40 pages</b>
<b>Testing Laboratory.....:</b>	<b>Shenzhen BCTC Testing Co., Ltd.</b>
<b>Address.....:</b>	BCTC Building & 1-2F, East of B Building, Pengzhou Industrial, Fuyuan 1st Road, Qiaotou Community, Fuyong Street, Bao'an District, Shenzhen, China
<b>Applicant's name.....:</b>	<b>EXTRA LIGHTING MANUFACTURING LTD</b>
<b>Address.....:</b>	<b>NO. 19 Yunpu 1st Road Yunpu Industrial Zone, Guangzhou, 510530 China</b>
<b>Test specification:</b>	
<b>Standard.....:</b>	IEC 60598-1:2014, IEC 60598-2-2:2011; EN 60598-1:2015, EN 60598-2-2:2012; EN 62031:2008+A1:2013+A2:2015.
<b>Test procedure.....:</b>	CE-LVD
<b>Non-standard test method.....:</b>	N/A
<b>Test Report Form No.....:</b>	IEC60598_2_2E
<b>Test Report Form(s) Originator.....:</b>	Intertek Semko AB
<b>Master TRF.....:</b>	2016-04
<b>Test item description.....:</b>	LED DOWN LIGHT
<b>Trade Mark.....:</b>	N/A
<b>Manufacturer.....:</b>	EXTRA LIGHTING MANUFACTURING LTD NO. 19 Yunpu 1st Road Yunpu Industrial Zone, Guangzhou, 510530 China
<b>Model/Type reference.....:</b>	RH-CL3181 RH-CL3180, RH-CL3182, RH-CL2026, RH-CL2036, RH-CL0320, RH-CL0321, RH-CL0322, RH-CL0323, RH-CL0324, RH-CL2600, RH-CL2601, RH-CL2602, RH-CL2603, RH-CL2604, RH-CL0605, RH-CL6006, RH-CL6008, RH-CL6009.
<b>Ratings.....:</b>	AC220-240V~, 50/60Hz, 30W



**Testing procedure and testing location:**

**Testing Laboratory**.....: **Shenzhen BCTC Testing Co., Ltd.**

**Address**.....: BCTC Building & 1-2F, East of B Building, Pengzhou Industrial, Fuyuan 1st Road, Qiaotou Community, Fuyong Street, Bao'an District, Shenzhen, China  
-----

**Date of Test**.....: **Sep. 15, 2017 – Sep. 29, 2017**  
-----

**Tested by (name + signature)**.....: Pual Zhong *pual zhong*  
-----

**Reviewed by (name + signature)**.....: Seven Zheng *Seven zheng*  
-----

**Approved by (name + signature)**.....: Awen He  
-----



**List of Attachments (including a total number of pages in each attachment):****Attachment No. 1: EN 60598-2-2:2012 used in conjunction with EN 60598-1:2015****Attachment No. 2: EN 62031:2008 + A1:2013 + A2:2015****Appendix 1: Photo documentation.****Summary of testing:****Tests performed (name of test and test clause):**

- EN 60598-1: 2015
- EN 60598-2-2: 2012;
- EN 62031:2008+A1:2013+A2:2015

**Testing location:****Shenzhen BCTC Testing Co., Ltd.**BCTC Building & 1-2F, East of B Building,  
Pengzhou Industrial, Fuyuan 1st Road, Qiaotou  
Community, Fuyong Street, Bao'an District,  
Shenzhen, China**Copy of marking plate:****The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.****LED DOWN LIGHT**  
Model: RH-CL3181  
AC220-240V~, 50/60Hz, 30W**Import: XXXXXX****Address: XXXXXX****Manufacturer: EXTRA LIGHTING MANUFACTURING LTD****Address: NO. 19 Yunpu 1st Road Yunpu Industrial Zone,  
Guangzhou, 510530 China****Made in China**



<b>Test item particulars</b> ..... :	
<b>Classification of installation and use</b> ..... : Recessed luminaires for indoor use only	
<b>Supply Connection</b> ..... : Power cord supply	
..... :	
<b>Possible test case verdicts:</b>	
- test case does not apply to the test object..... : N/A	
- test object does meet the requirement..... : P (Pass)	
- test object does not meet the requirement..... : F (Fail)	
<b>General remarks:</b>	
"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report.	
<b>Throughout this report a <input type="checkbox"/> comma / <input checked="" type="checkbox"/> point is used as the decimal separator.</b>	
Clause numbers between brackets refer to clauses in IEC 60598-1	
<b>Manufacturer's Declaration per sub-clause 4.2.5 of IEC 02:</b>	
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided..... :	<input type="checkbox"/> <b>Yes</b> <input checked="" type="checkbox"/> <b>Not applicable</b>
<b>General product information:</b>	
All the test results comply with the requirement of relevant standards.	



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
<b>2.3 (0)</b>	<b>GENERAL TEST REQUIREMENTS</b>		P
2.3 (0.1)	Information for luminaire design considered..... :	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> Lamp standard:	—
2.3 (0.3)	More sections applicable..... :	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Section/s:	—

<b>2.5 (2)</b>	<b>CLASSIFICATION OF LUMINAIRES</b>		P
2.5 (2.2)	Type of protection .....	Class II	P
2.5 (2.3)	Degree of protection..... :	IP20	P
2.5 (2.4)	Luminaire suitable for direct mounting on normally flammable surfaces..... :	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
2.5 (2.5)	Luminaire for normal use .....	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	Luminaire for rough service .....	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—

<b>2.6 (3)</b>	<b>MARKING</b>		P
2.6 (3.2)	Mandatory markings	(See marking plate)	P
	Position of the marking	On the enclosure	P
	Format of symbols/text	Symbols: 5.0mm min; Letter: 2.0 mm min.	P
2.6 (3.3)	Additional information	User manual provided	P
	Language of instructions	English	P
2.6 (3.3.1)	Combination luminaires	Not combination luminaire	N/A
2.6 (3.3.2)	Nominal frequency in Hz		N/A
2.6 (3.3.3)	Operating temperature		N/A
2.6 (3.3.4)	Symbol or warning notice	Suitable for direct mounting on normally flammable surfaces	N/A
2.6 (3.3.5)	Wiring diagram		N/A
2.6 (3.3.6)	Special conditions		N/A
2.6 (3.3.7)	Metal halide lamp luminaire – warning		N/A
2.6 (3.3.8)	Limitation for semi-luminaires		N/A
2.6 (3.3.9)	Power factor and supply current		N/A
2.6 (3.3.10)	Suitability for use indoors		P
2.6 (3.3.11)	Luminaires with remote control		N/A
2.6 (3.3.12)	Clip-mounted luminaire – warning		N/A
2.6 (3.3.13)	Specifications of protective shields		N/A
2.6 (3.3.14)	Symbol for nature of supply	Symbol: ~	P
2.6 (3.3.15)	Rated current of socket outlet	No socket outlet	N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.6 (3.3.16)	Rough service luminaire	Not rough service luminaire	N/A
2.6 (3.3.17)	Mounting instruction for type Y, type Z and some type X attachments	type Y	P
2.6 (3.3.18)	Non-ordinary luminaires with PVC cable	ordinary luminaire	N/A
2.6 (3.3.19)	Protective conductor current in instruction if applicable		N/A
2.6 (3.3.20)	Provided with information if not intended to be mounted within arm's reach	Out of arm's reach	N/A
2.6 (3.3.21)	Non replaceable and non-user replaceable light sources information provided	Non-user replaceable light source	N/A
	Cautionary symbol		N/A
2.6 (3.3.22)	Controllable luminaires, classification of insulation provided		N/A
2.6 (3.4)	Test with water	15s with water	P
	Test with hexane	15s with hexane	P
	Legible after test	Yes	P
	Label attached	Label can not be easily removable and show no curling	P

<b>2.7 (4)</b>	<b>CONSTRUCTION</b>		P
2.7 (4.2)	Components replaceable without difficulty		P
2.7 (4.3)	Wireways smooth and free from sharp edges		P
<b>2.7 (4.4)</b>	<b>Lampholders</b>		N/A
2.7 (4.4.1)	Integral lampholder	LED modules used, No lampholder	N/A
2.7 (4.4.2)	Wiring connection		N/A
2.7 (4.4.3)	Lampholder for end-to-end mounting		N/A
2.7 (4.4.4)	Positioning		N/A
	- pressure test (N) .....		—
	After test the lampholder comply with relevant standard sheets and show no damage		N/A
	After test on single-capped lampholder the lampholder have not moved from its position and show no permanent deformation		N/A
	- bending test (N) .....		—
	After test the lampholder have not moved from its position and show no permanent deformation		N/A
2.7 (4.4.5)	Peak pulse voltage		N/A
2.7 (4.4.6)	Centre contact		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.7 (4.4.7)	Parts in rough service luminaires resistant to tracking		N/A
2.7 (4.4.8)	Lamp connectors		N/A
2.7 (4.4.9)	Caps and bases correctly used		N/A
2.7 (4.4.10)	Light source for lampholder or connection according IEC 60061 not connected another way		N/A
<b>2.7 (4.5)</b>	<b>Starter holders</b>		N/A
	Starter holder in luminaires other than class II		N/A
	Starter holder class II construction		N/A
<b>2.7 (4.6)</b>	<b>Terminal blocks</b>		N/A
	Tails		N/A
	Unsecured blocks		N/A
<b>2.7 (4.7)</b>	<b>Terminals and supply connections</b>		N/A
2.7 (4.7.1)	Contact to metal parts		N/A
2.7 (4.7.2)	Test 8 mm live conductor		N/A
	Test 8 mm earth conductor		N/A
2.7 (4.7.3)	Terminals for supply conductors	Approved LED driver used	N/A
2.7 (4.7.3.1)	Welded method and material		N/A
	- stranded or solid conductor		N/A
	- spot welding		N/A
	- welding between wires		N/A
	- Type Z attachment		N/A
	- mechanical test according to 15.6.2		N/A
	- electrical test according to 15.6.3		N/A
	- heat test according to 15.6.3.2.3 and 15.6.3.2.4		N/A
2.7 (4.7.4)	Terminals other than supply connection		N/A
2.7 (4.7.5)	Heat-resistant wiring/sleeves		N/A
2.7 (4.7.6)	Multi-pole plug		N/A
	- test at 30 N		N/A
<b>2.7 (4.8)</b>	<b>Switches</b>	<b>No such Switches</b>	N/A
	- adequate rating		N/A
	- adequate fixing		N/A
	- polarized supply		N/A
	- compliance with IEC 61058-1 for electronic switches		N/A
<b>2.7 (4.9)</b>	<b>Insulating lining and sleeves</b>		N/A
2.7 (4.9.1)	Retainment		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	Method of fixing.....:		N/A
2.7 (4.9.2)	Insulated linings and sleeves:		N/A
	Resistant to a temperature > 20 °C to the wire temperature or	No such Insulated linings and sleeves	N/A
	a) & c) Insulation resistance and electric strength		N/A
	b) Ageing test. Temperature (°C).....:		N/A
<b>2.7 (4.10)</b>	<b>Double or reinforced insulation</b>		<b>P</b>
2.7 (4.10.1)	No contact, mounting surface – accessible metal parts – wiring of basic insulation		N/A
	Safe installation fixed luminaires		N/A
	Capacitors and switches		N/A
	Interference suppression capacitors according to IEC 60384-14		N/A
2.7 (4.10.2)	Assembly gaps:		N/A
	- not coincidental		N/A
	- no straight access with test probe		N/A
2.7 (4.10.3)	Retainment of insulation:		P
	- fixed		P
	- unable to be replaced; luminaire inoperative		N/A
	- sleeves retained in position		N/A
	- lining in lampholder		N/A
2.7 (4.10.4)	Protective impedance device	No such Protective impedance device	N/A
	Double or reinforced insulation bridged by appropriate and at least two resistors or two Y2 capacitors or one Y1 capacitor		N/A
	Y1 or Y2 capacitors comply with IEC 60384-14		N/A
	Resistors comply with test (a) in 14.1 of IEC 60065		N/A
<b>2.7 (4.11)</b>	<b>Electrical connections and current-carrying parts</b>		<b>P</b>
2.7 (4.11.1)	Contact pressure		P
2.7 (4.11.2)	Screws:		P
	- self-tapping screws		N/A
	- thread-cutting screws		P
2.7 (4.11.3)	Screw locking:		P
	- spring washer		P
	- rivets		N/A
2.7 (4.11.4)	Material of current-carrying parts		P
2.7 (4.11.5)	No contact to wood or mounting surface		P





IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.7 (4.11.6)	Electro-mechanical contact systems		N/A
<b>2.7 (4.12)</b>	<b>Screws and connections (mechanical) and glands</b>		<b>P</b>
2.7 (4.12.1)	Screws not made of soft metal		P
	Screws of insulating material		N/A
	Torque test: torque (Nm); part..... :	Screws for fixing enclosure: 2.82mm, 0.5Nm, 5 times	P
	Torque test: torque (Nm); part..... :		N/A
	Torque test: torque (Nm); part..... :		N/A
2.7 (4.12.2)	Screws with diameter < 3 mm screwed into metal		P
2.7 (4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm)..... :	No such fixed arms	N/A
	- lampholder; torque (Nm)..... :	No such lampholder	N/A
	- push-button switches; torque 0,8 Nm..... :	No such switches	N/A
2.7 (4.12.5)	Screwed glands; force (Nm)..... :	No such Screwed glands	N/A
<b>2.7 (4.13)</b>	<b>Mechanical strength</b>		<b>P</b>
2.7 (4.13.1)	Impact tests:		P
	- fragile parts; energy (Nm)..... :	0.2Nm for fragile parts	P
	- other parts; energy (Nm)..... :	0.35Nm for other parts	P
	1) live parts		P
	2) linings		N/A
	3) protection		P
	4) covers		P
2.7 (4.13.3)	Straight test finger	30N	P
2.7 (4.13.4)	Rough service luminaires		N/A
	- IP54 or higher	Ordinary luminaires	N/A
	a) fixed		N/A
	b) hand-held		N/A
	c) delivered with a stand		N/A
	d) for temporary installations and suitable for mounting on a stand		N/A
2.7 (4.13.6)	Tumbling barrel		N/A
<b>2.7 (4.14)</b>	<b>Suspensions, fixings and means of adjusting</b>		<b>P</b>
2.7 (4.14.1)	Mechanical load:		P
	A) four times the weight	1.38kgx4=5.52kg	P
	B) torque 2,5 Nm		P
	C) bracket arm; bending moment (Nm)..... :		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	D) load track-mounted luminaires		N/A
	E) clip-mounted luminaires, glass-shelve. Thickness (mm) .....		N/A
	Metal rod. diameter (mm) .....		N/A
	Fixed luminaire or independent control gear without fixing devices		N/A
2.7 (4.14.2)	Load to flexible cables		N/A
	Mass (kg) .....		—
	Stress in conductors (N/mm <sup>2</sup> ) .....		N/A
	Mass (kg) of semi-luminaire .....		N/A
	Bending moment (Nm) of semi-luminaire .....		N/A
2.7 (4.14.3)	Adjusting devices:		N/A
	- flexing test; number of cycles.....	No adjusting devices	N/A
	- strands broken.....		N/A
	- electric strength test afterwards		N/A
2.7 (4.14.4)	Telescopic tubes: cords not fixed to tube; no strain on conductors	No telescopic tubes	N/A
2.7 (4.14.5)	Guide pulleys	No guide pulleys	N/A
2.7 (4.14.6)	Strain on socket-outlets	No socket-outlet	N/A
<b>2.7 (4.15)</b>	<b>Flammable materials</b>		<b>N/A</b>
	- glow-wire test 650°C.....	See Test Table 2.16 (13.3.2)	N/A
	- spacing ≥30 mm		N/A
	- screen withstanding test of 13.3.1		N/A
	- screen dimensions		N/A
	- no fiercely burning material		P
	- thermal protection		N/A
	- electronic circuits exempted		N/A
2.7 (4.15.2)	Luminaires made of thermoplastic material with lamp control gear		N/A
	a) construction		N/A
	b) temperature sensing control		N/A
	c) surface temperature		N/A
<b>2.7 (4.16)</b>	<b>Luminaires for mounting on normally flammable surfaces</b>		<b>P</b>
	No lamp control gear.....	(compliance with Section 12)	N/A
2.7 (4.16.1)	Lamp control gear spacing:		P
	- spacing 35 mm		P
	- spacing 10 mm		N/A
2.7 (4.16.2)	Thermal protection:		N/A



<b>IEC 60598-2-2</b>			
Clause	Requirement + Test	Result - Remark	Verdict
	- in lamp control gear		N/A
	- external		N/A
	- fixed position		N/A
	- temperature marked lamp control gear		N/A
2.7 (4.16.3)	Design to satisfy the test of 12.6	(see clause 12.6)	N/A
<b>2.7 (4.17)</b>	<b>Drain holes</b>		N/A
	Clearance at least 5 mm		N/A
<b>2.7 (4.18)</b>	<b>Resistance to corrosion</b>		N/A
2.7 (4.18.1)	- rust-resistance		N/A
2.7 (4.18.2)	- season cracking in copper		N/A
2.7 (4.18.3)	- corrosion of aluminium		N/A
2.7 (4.19)	Igniters compatible with ballast		N/A
2.7 (4.20)	Rough service vibration		N/A
<b>2.7 (4.21)</b>	<b>Protective shield</b>		N/A
2.7 (4.21.1)	Shield fitted if tungsten halogen lamps or metal halide lamps		N/A
	Shield of glass if tungsten halogen lamps		N/A
2.7 (4.21.2)	Particles from a shattering lamp not impair safety		N/A
2.7 (4.21.3)	No direct path		N/A
2.7 (4.21.4)	Impact test on shield		
	Glow-wire test on lamp compartment.....:	See Test Table 2.16 (13.3.2)	N/A
2.7 (4.22)	Attachments to lamps not cause overheating or damage		N/A
2.7 (4.23)	Semi-luminaires comply Class II		N/A
<b>2.7 (4.24)</b>	<b>Photobiological hazards</b>		<b>P</b>
2.7 (4.24.1)	No excessive UV radiation if tungsten halogen lamps and metal halide lamps (Annex P)		N/A
2.7 (4.24.2)	Retinal blue light hazard		P
	Class of risk group assessed according to IEC/TR 62778 .....		—
	Luminaires with $E_{thr}$ :		P
	a) Fixed luminaires		P
	- distance x m, borderline between RG1 and RG2... :		P
	- marking and instruction according 3.2.23		N/A
	b) Portable and handheld luminaires		N/A
	- marking according 3.2.23 if RG1 exceeded at 200 mm according to IEC/TR 62778		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	Portable luminaires for children IEC 60598-2-10 and Mains socket outlet nightlights IEC 60598-2-12 not exceed RG1 at 200 mm according to IEC/62778		N/A
<b>2.7 (4.25)</b>	<b>Mechanical hazard</b>		<b>P</b>
	No sharp point or edges		P
<b>2.7 (4.26)</b>	<b>Short-circuit protection</b>		N/A
2.7 (4.26.1)	Adequate means of uninsulated accessible SELV parts		N/A
2.7 (4.26.2)	Short-circuit test with test chain according 4.26.3		N/A
	Test chain not melt through		N/A
	Test sample not exceed values of Table 12.1 and 12.2		N/A
<b>2.7 (4.27)</b>	<b>Terminal blocks with integrated screwless earthing contacts</b>		N/A
	Test according Annex V		N/A
	Pull test of terminal fixing (20 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Pull test of mechanical connection (50 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Voltage drop test, resistance < 0,05 Ω		N/A
<b>2.7 (4.28)</b>	<b>Fixing of thermal sensing control</b>		N/A
	Not plug-in or easily replaceable type		N/A
	Reliably kept in position		N/A
	No adhesive fixing if UV radiations from a lamp can degrade the fixing		N/A
	Not outside the luminaire enclosure		N/A
	Test of adhesive fixing:		N/A
	Max. temperature on adhesive material (°C) ..... :		—
	100 cycles between t min and t max		N/A
	Temperature sensing control still in position		N/A
<b>2.7 (4.29)</b>	<b>Luminaires with non-replaceable light source</b>		<b>P</b>
	Not possible to replace light source		P
	Live part not accessible after parts have been opened by hand or tools		P
<b>2.7 (4.30)</b>	<b>Luminaires with non-user replaceable light source</b>		N/A
	If protective cover provide protection against electric shock and marked with “caution, electric shock risk” symbol:		N/A
	Minimum two fixing means		N/A
<b>2.7 (4.31)</b>	<b>Insulation between circuits</b>		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	Circuits insulated from LV supply fulfil requirements according 4.31.1 – 4.31.3		N/A
	Controllable luminaires requiring same level of insulation for all components, the insulation between control terminals and LV supply fulfil requirements according 4.31.1 – 4.31.3		N/A
2.7 (4.31.1)	SELV circuits		P
	Used SELV source	LED driver tested according to IEC 61347-2-13	P
	Voltage $\leq$ ELV		N/A
	Insulating of SELV circuits from LV supply		P
	Insulating of SELV circuits from other non SELV circuits		N/A
	Insulating of SELV circuits from FELV		N/A
	Insulating of SELV circuits from other SELV circuits		N/A
	SELV circuits insulated from accessible parts according Table X.1		P
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Plugs and socket-outlets does not have protective conductor contact		N/A
2.7 (4.31.2)	FELV circuits		N/A
	Used FELV source		N/A
	Voltage $\leq$ ELV		N/A
	Insulating of FELV circuits from LV supply		N/A
	FELV circuits insulated from accessible parts according Table X.1		N/A
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Socket-outlets does not have protective conductor contact		N/A
2.7 (4.31.3)	Other circuits		N/A
	Other circuits insulated from accessible parts according Table X.1		N/A
	Class II construction with equipotential bonding for protection against indirect contacts with live parts:		N/A
	- conductive parts are connected together		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- test according 7.2.3		N/A
	- conductive part not cause an electric shock in case of an insulation fault		N/A
	- equipotential bonding in master/slave applications		N/A
	- master luminaire provided with terminal for accessible conductive parts of slave luminaires		N/A
	- slave luminaire constructed as class I		N/A
<b>2.7 (4.32)</b>	<b>Overvoltage protective devices</b>		N/A
	Comply with IEC 61643-11		N/A
	External to controlgear and connected to earth:		N/A
	- only in fixed luminaires		N/A
	- only connected to protective earth		N/A

<b>2.8 (11)</b>	<b>CREEPAGE DISTANCES AND CLEARANCES</b>		P
2.8 (11.2)	Creepage distances and clearances.....:		P
	Impulse withstand category (Normal category II) (Category III Annex U, Table U.1)	Category II <input checked="" type="checkbox"/> Category III <input type="checkbox"/>	—

<b>2.9 (7)</b>	<b>PROVISION FOR EARTHING</b>		N/A
2.9 (7.2.1 + 7.2.3)	Accessible metal parts		N/A
	Metal parts in contact with supporting surface		N/A
	Resistance < 0,5 Ω.....:		N/A
	Self-tapping screws used		N/A
	Thread-forming screws		N/A
	Thread-forming screw used in a grove		N/A
	Earth makes contact first		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
	Protective earthing of the luminaire not via built-in control gear		N/A
2.9 (7.2.2 + 7.2.3)	Earth continuity in joints, etc.		N/A
2.9 (7.2.4)	Locking of clamping means		N/A
	Compliance with 4.7.3		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
2.9 (7.2.5)	Earth terminal integral part of connector socket		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.9 (7.2.6)	Earth terminal adjacent to mains terminals		N/A
2.9 (7.2.7)	Electrolytic corrosion of the earth terminal		N/A
2.9 (7.2.8)	Material of earth terminal		N/A
	Contact surface bare metal		N/A
2.9 (7.2.10)	Class II luminaire for looping-in		N/A
	Double or reinforced insulation to functional earth		N/A
2.9 (7.2.11)	Earthing core coloured green-yellow		N/A
	Length of earth conductor		N/A

2.10 (14)	SCREW TERMINALS		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the luminaire	(see Annex 3)	N/A

2.10 (15)	SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS		N/A
	Separately approved; component list.....:	(see Annex 1)	N/A
	Part of the luminaire.....:	(see Annex 4)	N/A

2.11 (5)	EXTERNAL AND INTERNAL WIRING		P
2.11 (5.2)	Supply connection and external wiring		P
2.11 (5.2.1)	Means of connection.....:		P
	Outdoor luminaire has not PVC insulated external wiring if not class III or SELV ≤ 25 V a.c./60 V d.c. or protected from outdoor environment		N/A
2.11 (5.2.2)	Type of cable.....:	See ANNEX 1	P
	Nominal cross-sectional area (mm <sup>2</sup> ).....:	See ANNEX 1	P
	Cables equal to IEC 60227 or IEC 60245		P
2.11 (5.2.3)	Type of attachment, X, Y or Z	Type Y	P
2.11 (5.2.5)	Type Z not connected to screws		N/A
2.11 (5.2.6)	Cable entries:		N/A
	- suitable for introduction		N/A
	- adequate degree of protection		N/A
2.11 (5.2.7)	Cable entries through rigid material have rounded edges		N/A
2.11 (5.2.8)	Insulating bushings:		N/A
	- suitably fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- tubes or guards made of insulating material		N/A
2.11 (5.2.9)	Locking of screwed bushings		N/A
2.11 (5.2.10)	Cord anchorage:		P
	- covering protected from abrasion		P
	- clear how to be effective		P
	- no mechanical or thermal stress		P
	- no tying of cables into knots etc.		P
	- insulating material or lining		P
2.11 (5.2.10.1)	Cord anchorage for type X attachment:		N/A
	a) at least one part fixed		N/A
	b) types of cable		N/A
	c) no damaging of the cable		N/A
	d) whole cable can be mounted		N/A
	e) no touching of clamping screws		N/A
	f) metal screw not directly on cable		N/A
	g) replacement without special tool		N/A
	Glands not used as anchorage		N/A
	Labyrinth type anchorages		N/A
2.11 (5.2.10.2)	Adequate cord anchorage for type Y and type Z attachment	type Y	P
2.11 (5.2.10.3)	Tests:		P
	- impossible to push cable; unsafe		P
	- pull test: 25 times; pull (N)..... : 30 N		P
	- torque test: torque (Nm)..... : 0,08 Nm		P
	- displacement ≤ 2 mm	0,2mm	P
	- no movement of conductors		P
	- no damage of cable or cord		P
	- function independent of electrical connection		N/A
2.11 (5.2.11)	External wiring passing into luminaire		P
2.11 (5.2.12)	Looping-in terminals		N/A
2.11 (5.2.13)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		N/A





IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.11 (5.2.14)	Mains plug same protection		N/A
	Class III luminaire plug		N/A
	No unsafe compatibility		N/A
2.11 (5.2.16)	Appliance inlets (IEC 60320)		N/A
	Installation couplers (IEC 61535)		N/A
	Other appliance inlet or connector according relevant IEC standard		N/A
2.11 (5.2.17)	No standardized interconnecting cables properly assembled		N/A
2.11 (5.2.18)	Used plug in accordance with		N/A
	- IEC 60083		N/A
	- other standard		N/A
<b>2.11 (5.3)</b>	<b>Internal wiring</b>		<b>P</b>
2.11 (5.3.1)	Internal wiring of suitable size and type		P
	Through wiring		N/A
	- not delivered/ mounting instruction		N/A
	- factory assembled		N/A
	- socket outlet loaded (A)..... :		N/A
	- temperatures..... :	(see Annex 2)	N/A
	Green-yellow for earth only		N/A
2.11 (5.3.1.1)	Internal wiring connected directly to fixed wiring		P
	Cross-sectional area (mm <sup>2</sup> )..... :	See ANNEX 1	P
	Insulation thickness	See ANNEX 1	P
	Extra insulation added where necessary		N/A
2.11 (5.3.1.2)	Internal wiring connected to fixed wiring via internal current-limiting device		N/A
	Adequate cross-sectional area and insulation thickness		N/A
2.11 (5.3.1.3)	Double or reinforced insulation for class II		P
2.11 (5.3.1.4)	Conductors without insulation		N/A
2.11 (5.3.1.5)	SELV current-carrying parts		P
2.11 (5.3.1.6)	Insulation thickness other than PVC or rubber		N/A

**IEC 60598-2-2**

Clause	Requirement + Test	Result - Remark	Verdict
2.11 (5.3.2)	Sharp edges etc.		P
	No moving parts of switches etc.		N/A
	Joints, raising/lowering devices		N/A
	Telescopic tubes etc.		N/A
	No twisting over 360°		P
2.11 (5.3.3)	Insulating bushings:		P
	- suitable fixed		P
	- material in bushings		P
	- material not likely to deteriorate		P
	- cables with protective sheath		P
2.11 (5.3.4)	Joints and junctions effectively insulated		P
2.11 (5.3.5)	Strain on internal wiring		N/A
2.11 (5.3.6)	Wire carriers		N/A
2.11 (5.3.7)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		N/A

<b>2.12 (8)</b>	<b>PROTECTION AGAINST ELECTRIC SHOCK</b>		P
2.12 (8.2.1)	Live parts not accessible		P
	Basic insulated parts not used on the outer surface without appropriate protection		P
	Basic insulated parts not accessible with standard test finger on portable, settable and adjustable luminaires		P
	Basic insulated parts not accessible with Ø 50 mm probe from outside, other types of luminaires		P
	Lamp and starterholders in portable and adjustable luminaires comply with double or reinforced insulation requirements		N/A
	Basic insulation only accessible under lamp or starter replacement		N/A
	Protection in any position		P
	Double-ended tungsten filament lamp		N/A
	Insulation lacquer not reliable		P
	Double-ended high pressure discharge lamp		N/A
	Relevant warning according to 3.2.18 fitted to the luminaire		N/A
2.12 (8.2.2)	Portable luminaire adjusted in most unfavourable position		N/A



<b>IEC 60598-2-2</b>			
Clause	Requirement + Test	Result - Remark	Verdict
2.12 (8.2.3.a)	Class II luminaire:		N/A
	- basic insulated metal parts not accessible during starter or lamp replacement		N/A
	- basic insulation not accessible other than during starter or lamp replacement		N/A
	- glass protective shields not used as supplementary insulation		N/A
2.12 (8.2.3.b)	BC lampholder of metal in class I luminaires shall be earthed		N/A
2.12 (8.2.3.c)	SELV circuits with exposed current carrying parts:		N/A
	Ordinary luminaire:		N/A
	- voltage under load (V).....:		N/A
	- no-load voltage (V).....:		N/A
	- touch current if applicable (mA) .....		N/A
	One conductive part insulated if required		N/A
	Other than ordinary luminaire:		N/A
	- nominal voltage (V) .....		N/A
	Class III luminaire only for connection to SELV		P
	Class III luminaire not provided with means for protective earthing		P
2.12 (8.2.4)	Portable luminaire have protection independent of supporting surface		N/A
2.12 (8.2.5)	Compliance with the standard test finger or relevant probe		P
2.12 (8.2.6)	Covers reliably secured		P
2.12 (8.2.7)	Luminaire other than below with capacitor > 0,5 μF not exceed 50 V 1 min after disconnection	Approved by LED driver	N/A
	Portable luminaire with capacitor > 0,1 μF (0.25) not exceed 34 V 1 s after disconnection		N/A
	Other luminaires with capacitor > 0,1 μF (0.25) with plug and track adaptors not exceed 60 V 5 s after disconnection		N/A
2.12 (-)	Parts within the ceiling space provide same degree of protection against electric shock as parts below the ceiling space		N/A
<b>2.13 (12)</b>	<b>ENDURANCE TEST AND THERMAL TEST</b>		P
2.13 (-)	If IP > IP 20 relevant test of (12.4), (12.5) and (12.6) after (9.2) before (9.3) specified in 2.14		—



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.13 (12.3)	Endurance test:		P
	- mounting- position..... :	Normal Position	—
	- test temperature (°C)..... :	35°C	—
	- total duration (h)..... :	240	—
	- supply voltage: Un factor; calculated voltage (V)... :	1.1x240=264V	—
	- lamp used..... :	LED lamps	—
2.13 (12.3.2)	After endurance test:		P
	- no part unserviceable		P
	- luminaire not unsafe		P
	- no damage to track system	No such track system	N/A
	- marking legible		P
	- no cracks, deformation etc.		P
2.13 (12.4)	Thermal test (normal operation)	(see Annex 2)	P
2.13 (12.5)	Thermal test (abnormal operation)	(see Annex 2)	N/A
2.13 (12.6)	Thermal test (failed lamp control gear condition):		N/A
2.13 (12.6.1)	Through wiring or looping-in wiring loaded by a current of (A) .....		—
	- case of abnormal conditions..... :		—
	- electronic lamp control gear		N/A
	- measured winding temperature (°C): at 1,1 Un .....		—
	- measured mounting surface temperature (°C) at 1,1 Un..... :		N/A
	- calculated mounting surface temperature (°C) .....		N/A
	- track- mounted luminaires		N/A
2.13 (12.6.2)	Temperature sensing control		N/A
	- case of abnormal conditions..... :		—
	- thermal link		N/A
	- manual reset cut-out		N/A
	- auto reset cut-out		N/A
	- measured mounting surface temperature (°C)..... :		N/A
	- track- mounted luminaires		N/A
2.13 (12.7)	Thermal test (failed lamp control gear in plastic luminaires):		N/A
2.13 (12.7.1)	Luminaire without temperature sensing control		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
2.13 (12.7.1.1)	Luminaire with fluorescent lamp ≤ 70W		N/A
	Test method 12.7.1.1 or Annex W .....		—
	Test according to 12.7.1.1:		N/A
	- case of abnormal conditions.....		—
	- Ballast failure at supply voltage (V) .....		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
	Test according to Annex W:		N/A
	- case of abnormal conditions.....		—
	- measured winding temperature (°C): at 1,1 Un.....		—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un.....		—
	- calculated temperature of fixing point/exposed part (°C).....		—
	Ball-pressure test.....	See Table 2.16 (13.2.1)	N/A
2.13 (12.7.1.2)	Luminaire with discharge lamp, fluorescent lamp > 70W, transformer > 10 VA		N/A
	- case of abnormal conditions.....		—
	- measured winding temperature (°C): at 1,1 Un.....		—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un.....		—
	- calculated temperature of fixing point/exposed part (°C).....		—
	Ball-pressure test.....	See Table 2.16 (13.2.1)	N/A
2.13 (12.7.1.3)	Luminaire with short circuit proof transformers ≤ 10 VA		N/A
	- case of abnormal conditions.....		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
2.13 (12.7.2)	Luminaire with temperature sensing control		N/A
	- thermal link.....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- manual reset cut-out.....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- auto reset cut-out.....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- case of abnormal conditions.....		—
	- highest measured temperature of fixing point/ exposed part (°C):.....		—



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	Ball-pressure test:.....	See Table 2.16 (13.2.1)	N/A
2.13.1 (-)	Wiring, for connection to the supply, not reach unsafe temperature		P
	- measured temperature of the cable (°C) .....	42,2°C (limit: 90°C)	P

<b>2.14 (9)</b>	<b>RESISTANCE TO DUST AND MOISTURE</b>		P
2.14 (-)	If IP > IP 20 the order of tests as specified in clause 2.13		N/A
2.14 (9.2)	Tests for ingress of dust, solid objects and moisture:		P
	- classification according to IP.....	IP20	—
	- mounting position during test.....	As in normal use	—
	- fixing screws tightened; torque (Nm).....		—
	- tests according to clauses.....		—
	- electric strength test afterwards		N/A
	a) no deposit in dust-proof luminaire		N/A
	b) no talcum in dust-tight luminaire		N/A
	c) no trace of water on current-carrying parts or on insulation where it could become a hazard		N/A
	c.1) For luminaires without drain holes – no water entry		N/A
	c.2) For luminaires with drain holes – no hazardous water entry		N/A
	d) no water in watertight or pressure watertight luminaire		N/A
	e) no contact with live parts (IP 2X)	IP20	P
	e) no entry into enclosure (IP 3X and IP 4X)		N/A
	e) no contact with live parts through drain holes and ventilation slots (IP3X and IP4X)		N/A
	f) no trace of water on part of lamp requiring protection from splashing water		N/A
	g) no damage of protective shield or glass envelope		N/A
2.14 (9.3)	Humidity test 48 h	25°C, 93% R.H.	P

<b>2.15 (10)</b>	<b>INSULATION RESISTANCE AND ELECTRIC STRENGTH</b>		P
2.15 (10.2.1)	Insulation resistance test		P
	Cable or cord covered by metal foil or replaced by a metal rod of mm Ø .....		—
	Insulation resistance (MΩ).....		—
	SELV		N/A



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- between current-carrying parts of different polarity:	>10MΩ	N/A
	- between current-carrying parts and mounting surface.....:	>10MΩ	N/A
	- between current-carrying parts and metal parts of the luminaire.....:	>10MΩ	N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts.....:		N/A
	- Insulation bushings as described in Section 5 .....		N/A
	Other than SELV		P
	- between live parts of different polarity.....:	> 100MΩ	P
	- between live parts and mounting surface.....:	> 100MΩ	P
	- between live parts and metal parts.....:	> 100MΩ	P
	- between live parts of different polarity through action of a switch.....:		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts.....:		N/A
	- Insulation bushings as described in Section 5 .....		N/A
2.15 (10.2.2)	Electric strength test		P
	Dummy lamp		N/A
	Luminaires with ignitors after 24 h test		N/A
	Luminaires with manual ignitors		N/A
	Test voltage (V).....:		N/A
	SELV		N/A
	- between current-carrying parts of different polarity:	500V	N/A
	- between current-carrying parts and mounting surface.....:	500V	N/A
	- between current-carrying parts and metal parts of the luminaire.....:	500V	N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts.....:		N/A
	- Insulation bushings as described in Section 5 .....		N/A
	Other than SELV		P
	- between live parts of different polarity.....:	1480V	P
	- between live parts and mounting surface.....:	2960V	P
	- between live parts and metal parts.....:	2960V	P



IEC 60598-2-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- between live parts of different polarity through action of a switch..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5 ..... :		N/A
2.15 (10.3)	Touch current or protective conductor current (mA):	0.025mA	P

2.16 (13)	RESISTANCE TO HEAT, FIRE AND TRACKING		N/A
2.16 (13.2.1)	Ball-pressure test..... :	See Test Table 2.16 (13.2.1)	N/A
2.16 (13.3.1)	Needle-flame test (10 s)..... :	See Test Table 2.16 (13.3.1)	N/A
2.16 (13.3.2)	Glow-wire test (650°C)..... :	See Test Table 2.16 (13.3.2)	N/A
2.16 (13.4)	Proof tracking test (IEC 60112)..... :	See Test Table 2.16 (13.4)	N/A





<b>1.7 (11.2)</b>	<b>TABLE: Creepage distances and clearances</b>						<b>P</b>
	<b>Minimum distances (mm) for a.c. (50/60 Hz) sinusoidal voltages</b>						<b>P</b>
	<b>Applicable part of IEC 60598-1 Table 11.1* and 11.2*</b>						<b>P</b>
	<b>Insulation type **</b>	<b>Measured clearance</b>	<b>Required</b>		<b>Measured creepage</b>	<b>Required</b>	
			<b>clearance</b>	<b>*Table</b>		<b>creepage</b>	<b>*Table</b>
Distance 1:	B	>1.5mm	1.5mm	11.1	>2.5mm	2.5mm	11.1
Working voltage (V)..... :					240		—
PTI..... :					< 600 <input checked="" type="checkbox"/> ≥ 600 <input type="checkbox"/>		—
Pulse voltage if applicable (kV) .....					2.5		—
Supplementary information:							
Distance 2:	--	--	--	--	--	--	--
Working voltage (V)..... :							—
PTI..... :					< 600 <input checked="" type="checkbox"/> ≥ 600 <input type="checkbox"/>		—
Pulse voltage if applicable (kV) .....							—
Supplementary information:							
Distance 3:	R	>3.0mm	3.0mm	11.1	>5.0mm	5.0mm	11.1
Working voltage (V)..... :					240		—
PTI..... :					< 600 <input checked="" type="checkbox"/> ≥ 600 <input type="checkbox"/>		—
Pulse voltage if applicable (kV) .....					2.5		—
Supplementary information:							

\*\* Insulation type: B – Basic; S – Supplementary; R – Reinforced. See also IEC 60598-1 Annex M.

<b>2.16 (13.2.1)</b>	<b>TABLE: Ball Pressure Test of Thermoplastics</b>				<b>N/A</b>	
<b>Allowed impression diameter (mm) .....</b>					2	—
<b>Object/ Part No./ Material</b>		<b>Manufacturer/ trademark</b>	<b>Test temperature (°C)</b>	<b>Impression diameter (mm)</b>		
--		--	--	--		
Supplementary information:						

<b>2.16 (13.3.1)</b>	<b>TABLE: Needle-flame test (IEC 60695-11-5)</b>				<b>N/A</b>
<b>Object/ Part No./ Material</b>	<b>Manufacturer/ trademark</b>	<b>Duration of application of test flame (ta); (s)</b>	<b>Ignition of specified layer Yes/No</b>	<b>Duration of burning (tb) (s)</b>	<b>Verdict</b>
--	--	--	--	--	--
Supplementary information:					



<b>2.16 (13.3.2)</b>	<b>TABLE: Glow-wire test (IEC 60695-2-11)</b>				<b>N/A</b>
<b>Glow wire temperature .....</b>				650°C	—
Object/ Part No./ Material	Manufacturer/ trademark	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict	
--	--	--	--	--	
Any flame or glowing of the sample extinguished within 30 s of withdrawing the glow-wire, and any burning or molten drop did not ignite the underlying parts (Yes/No).....					--
Supplementary information:					

<b>2.16 (13.4)</b>	<b>TABLE: Proof tracking test (IEC 60112)</b>				<b>N/A</b>
<b>Test voltage PTI .....</b>				175 V	—
Object/ Part No./ Material	Manufacturer/ trademark	Withstand 50 drops without failure on three places or on three specimens			Verdict
--	--	--	--	--	--
Supplementary information:					

<b>ANNEX 1</b>	<b>TABLE: Critical components information</b>					<b>P</b>
Component	manufacturers / trademark	Type / model	Value / rating	standard	Approval/ Reference	
Internal wire	DONGGUAN NISTARTRANSMITTING TECHNOLOGY CO., INC	3219	2 x 0,5 mm <sup>2</sup> 180°C	EN 60227	VDE	
Power cord	DONGGUAN NISTARTRANSMITTING TECHNOLOGY CO., INC	3310	2 x 0,75 mm <sup>2</sup> 180°C	EN 60227	VDE	
LED driver	OSRAM GmbH	OT FIT 30/220-240/700 CS	Input: 220-240V~,50/60Hz, MAX.29.4W Output:DC42V,0.7A	EN61347-1 EN61347-2-13	CE	



ANNEX 2		TABLE: Temperature measurements, thermal tests of Section 12				P	
	Type reference.....	RH-CL3181				—	
	Lamp used.....	LED				—	
	Lamp control gear used.....	---				—	
	Mounting position of luminaire.....	As in normal use				—	
	Supply wattage (W).....	30.5				—	
	Supply current (A).....	0.127				—	
	Calculated power factor.....	0.945				—	
	Table: measured temperatures corrected for ta = 25 °C:					P	
	- abnormal operating mode.....					—	
	- test 1: rated voltage.....					—	
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage.....	254,4V				—	
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage.....					—	
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage.....					—	
	Through wiring or looping-in wiring loaded by a current of A during the test .....					—	
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Input wire	24.6	--	30.4	--	80	--	--
PCB of LED module	24.6	--	49.7	--	130	--	--
Metal enclosure	24.6	--	38.5	--	60	--	--
LED Power supply enclosure	24.6	--	43.5	--	Ref.	--	--
Mounting surface	24.6	--	32.7	--	90	--	--
Supplementary information:							

ANNEX 3		Screw terminals (part of the luminaire)		N/A	
(14)	SCREW TERMINALS			N/A	
(14.2)	Type of terminal.....			—	
	Rated current (A).....			—	
(14.3.2.1)	One or more conductors			N/A	
(14.3.2.2)	Special preparation			N/A	



(14.3.2.3)	Terminal size		N/A
	Cross-sectional area (mm <sup>2</sup> )..... :		—
(14.3.3)	Conductor space (mm)..... :		N/A
(14.4)	Mechanical tests		N/A
(14.4.1)	Minimum distance		N/A
(14.4.2)	Cannot slip out		N/A
(14.4.3)	Special preparation		N/A
(14.4.4)	Nominal diameter of thread (metric ISO thread)..... :	M	N/A
	External wiring		N/A
	No soft metal		N/A
(14.4.5)	Corrosion		N/A
(14.4.6)	Nominal diameter of thread (mm)..... :		N/A
	Torque (Nm)..... :		N/A
(14.4.7)	Between metal surfaces		N/A
	Lug terminal		N/A
	Mantle terminal		N/A
	Pull test; pull (N)..... :		N/A
(14.4.8)	Without undue damage		N/A



<b>ANNEX 4</b>	<b>Screwless terminals (part of the luminaire)</b>	N/A
<b>(15)</b>	<b>SCREWLESS TERMINALS</b>	N/A
(15.2)	Type of terminal.....:	—
	Rated current (A).....:	—
(15.3.1)	Material	N/A
(15.3.2)	Clamping	N/A
(15.3.3)	Stop	N/A
(15.3.4)	Unprepared conductors	N/A
(15.3.5)	Pressure on insulating material	N/A
(15.3.6)	Clear connection method	N/A
(15.3.7)	Clamping independently	N/A
(15.3.8)	Fixed in position	N/A
(15.3.10)	Conductor size	N/A
	Type of conductor	N/A
(15.5)	Terminals and connections for internal wiring	N/A
(15.5.1)	Mechanical tests	N/A
(15.5.1.1.1)	Pull test spring-type terminals (4 N, 4 samples).....:	N/A
(15.5.1.1.2)	Pull test pin or tab terminals (4 N, 4 samples).....:	N/A
	Insertion force not exceeding 50 N	N/A
(15.5.1.2)	Permanent connections: pull-off test (20 N)	N/A
(15.5.2)	Electrical tests	N/A
	Voltage drop (mV) after 1 h (4 samples).....:	N/A
	Voltage drop of two inseparable joints	N/A
	Number of cycles:	—
	Voltage drop (mV) after 10th alt. 25th cycle (4 samples).....:	N/A
	Voltage drop (mV) after 50th alt. 100th cycle (4 samples).....:	N/A
	After ageing, voltage drop (mV) after 10th alt. 25th cycle (4 samples).....:	N/A
	After ageing, voltage drop (mV) after 50th alt. 100th cycle (4 samples).....:	N/A
(15.6)	Terminals and connections for external wiring	N/A
(15.6.1)	Conductors	N/A
	Terminal size and rating	N/A
15.6.2	Mechanical tests	N/A
(15.6.2.1)	Pull test spring-type terminals or welded connections (4 samples); pull (N) .....	N/A



(15.6.2.2)	Pull test pin or tab terminals (4 samples); pull (N) .....		N/A
(15.6.3)	Electrical tests		N/A
	Tests according 15.6.3.1 + 15.6.3.2 in IEC 60598-1		N/A

<b>(15.6.3.1)</b> <b>(15.6.3.2)</b>	<b>TABLE: Contact resistance test / Heating tests</b>										N/A
	Voltage drop (mV) after 1 h										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Voltage drop of two inseparable joints										
	Voltage drop after 10th alt. 25th cycle										
	Max. allowed voltage drop (mV).....:										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Voltage drop after 50th alt. 100th cycle										
	Max. allowed voltage drop (mV).....:										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Continued ageing: voltage drop after 10th alt. 25th cycle										
	Max. allowed voltage drop (mV).....:										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Continued ageing: voltage drop after 50th alt. 100th cycle										
	Max. allowed voltage drop (mV).....:										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Supplementary information:											



**Attachment No. 1**

IEC60598_2_2E - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict

<b>ATTACHMENT TO TEST REPORT IEC 60598-2-2</b> <b>EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES</b> Luminaires Part 2: Particular requirements Section 2: Recessed luminaires			
<b>Differences according to</b>	:	EN 60598-2-2:2012 used in conjunction with EN 60598-1:2015	
<b>Annex Form No.</b>	:	EU_GD_IEC60598_2_2E	
<b>Annex Form Originator</b>	:	OVE	
<b>Master Annex Form</b>	:	2015-04	
<b>Copyright © 2015 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.</b>			

	<b>CENELEC COMMON MODIFICATIONS (EN)</b>		<b>P</b>
--	--	--	----------

<b>2.6 (3)</b>	<b>MARKING</b>		<b>P</b>
2.6 (3.3.101)	For luminaires not supplied with terminal block: Adequate warning on the package		<b>P</b>

<b>2.7 (4)</b>	<b>CONSTRUCTION</b>		<b>P</b>
2.7 (4.11.6)	Electro-mechanical contact systems		N/A

<b>2.11 (5)</b>	<b>EXTERNAL AND INTERNAL WIRING</b>		<b>P</b>
2.11 (5.2.1)	Connecting leads		N/A
	- without a means for connection to the supply		N/A
	- terminal block specified		N/A
	- relevant information provided		N/A
	- compliance with 4.6, 4.7.1, 4.7.2, 4.10.1, 11.2, 12 and 13.2 of Part 1		N/A
<b>2.11 (5.2.2)</b>	<b>Cables equal to EN 50525</b>		<b>P</b>
	Replace table 5.1 – Supply cord		<b>P</b>

<b>2.13 (12)</b>	<b>ENDURANCE TESTS AND THERMAL TESTS</b>		<b>P</b>
2.13 (12.4.2c)	Thermal test (normal operation) see footnote c to table 12.2 relating to unsleeved fixed wiring		<b>P</b>
<b>ZB</b>	<b>ANNEX ZB, SPECIAL NATIONAL CONDITIONS (EN)</b>		N/A
(3.3)	DK: power supply cords of class I luminaires with label		N/A
(4.5.1)	DK: socket-outlets		N/A
(5.2.1)	CY, DK, FI, GB: type of plug		N/A



ZC	ANNEX ZC, NATIONAL DEVIATIONS (EN)		N/A
(4 & 5)	FR: Shuttered socket-outlets 10/16A		N/A
	FR: Safety requirements for high buildings  (Arrêté du 30 décembre 2011 portant règlement de sécurité pour la construction des immeubles de grande hauteur et leur protection contre les risques d'incendie et de panique; Section VIII; Article GH 48, Eclairage)  Glow-wire test for outer parts of luminaires:		N/A
	- 850°C for luminaires in stairways and horizontal travel paths		N/A
	- 650°C for indoor luminaires		N/A
	GB: Requirements according to United Kingdom Building Regulation		N/A





**Attachment No. 2**  
**EN 62031**

Clause	Requirement + Test	Result - Remark	Verdict
<b>4</b>	<b>GENERAL REQUIREMENTS</b>		—
4.4	Integral modules tested assembled in the luminaire		P
4.5	Independent modules complies with requirements in IEC 60598-1		N/A

<b>5</b>	<b>GENERAL TEST REQUIREMENTS</b>		—
5.5	SELV-operated LED modules comply with Annex I of IEC 61347-2-13	(see Annex 1)	N/A
	General conditions for tests in Annex A	(see Annex A)	P

<b>6</b>	<b>CLASSIFICATION</b>		—
	Built-in module:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Independent module:	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—
	Integral module:	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	For Integral module; Note to 1.2.1 in IEC 60598-1 applies.		—

<b>7</b>	<b>MARKING</b>		N/A
	Requirements not applicable to the evaluated product.		—

<b>8</b>	<b>TERMINALS</b>		N/A
	Screw terminals according section 14 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 2)	N/A
	Part of the luminaire	(see Annex 3)	N/A
	Screwless terminals according section 15 of IEC 60598-1:		N/A
	Separately approved; component list	(see Annex 2)	N/A
	Part of the luminaire	(see Annex 4)	N/A
	Connectors according IEC 60838-2-2:		N/A
	Separately approved; component list	(see Annex 2)	N/A

<b>9 (9)</b>	<b>PROVISION FOR PROTECTIVE EARTHING</b>		N/A
	Requirements not applicable to the evaluated product.		—
<b>10 (10)</b>	<b>PROTECTION AGAINST ACCIDENTAL CONTACT WITH LIVE PARTS</b>		N/A
	Requirements not applicable to the evaluated product.		—

<b>11 (11)</b>	<b>MOISTURE RESISTANCE AND INSULATION</b>		—
----------------	---	--	---



EN 62031			
Clause	Requirement + Test	Result - Remark	Verdict
	After storage 48 h at 91-95% relative humidity and 20-30 °C measuring of insulation resistance with d.c. 500 V (MΩ):		P
	For basic insulation $\geq 2 \text{ M}\Omega$ :	100MΩ	P
	For double or reinforced insulation $\geq 4 \text{ M}\Omega$ :		N/A
	Between primary and secondary circuits in controlgear providing SELV, values in Annex L in IEC 61347-1		N/A

12 (12)	ELECTRIC STRENGTH		—
	Immediately after clause 11 electric strength test for 1 min		P
	Basic insulation for SELV, test voltage 500 V		P
	Working voltage $\leq 50 \text{ V}$ , test voltage 500 V		N/A
	Working voltage $> 50 \text{ V} \leq 1000 \text{ V}$ , test voltage (V):		N/A
	Basic insulation, $2U + 1000 \text{ V}$		N/A
	Supplementary insulation, $2U + 1000 \text{ V}$		N/A
	Double or reinforced insulation, $4U + 2000 \text{ V}$		N/A
	No flashover or breakdown		P
	Solid or thin sheet insulation for double or reinforced insulation fulfil the requirements in Annex N in IEC 61347-1		N/A

13 (14)	FAULT CONDITIONS		—
- (14)	When operated under fault conditions the controlgear:		N/A
	- does not emit flames or molten material		N/A
	- does not produce flammable gases		N/A
	- protection against accidental contact not impaired		N/A
	Thermally protected controlgear does not exceed the marked temperature value		N/A
	Fault conditions: capacitors, resistors or inductors without proof of compliance with relevant specifications have been short-circuited or disconnected	(see appended table)	N/A
- (14.1)	Short-circuit of creepage distances and clearances if less than specified in clause 16 in Part 1 (except between live parts and accessible metal parts)	(see appended table)	N/A
	Creepage distances on printed boards less than specified in clause 16 in Part 1 provided with coating according to IEC 60664-3		N/A
- (14.2)	Short-circuit or interruption of semiconductor devices	(see appended table)	N/A



EN 62031			
Clause	Requirement + Test	Result - Remark	Verdict
- (14.3)	Short-circuit across insulation consisting of lacquer, enamel or textile	(see appended table)	N/A
- (14.4)	Short-circuit across electrolytic capacitors	(see appended table)	N/A
- (14.5)	After the tests has been carried out on three samples:		N/A
	The insulation resistance $\geq 1 \text{ M}\Omega$ :		N/A
	No flammable gases		N/A
	No accessible parts have become live		N/A
	During the tests, a five-layer tissue paper, where the test specimen is wrapped, does not ignite		N/A
- (14.6)	Relevant fault condition tests with high-power supply		N/A
<b>13.2</b>	<b>Overpower condition</b>		P
	Module withstands overpower condition >15 min.		P
	Module with automatic protective device or power limiter, test performed 15 min. at limit.		N/A
	No fire, smoke or flammable gas is produced		P
	Molten material does not ignite tissue paper, spread below the module		P

<b>15</b>	<b>CONSTRUCTION</b>		—
	Wood, cotton, silk, paper and similar fibrous material not used as insulation		P

<b>16 (16)</b>	<b>CREEPAGE DISTANCES AND CLEARANCES</b>		—
- (16)	Creepage and distances and clearances in compliance with IEC 61347-1		N/A
	Insulating lining of metallic enclosures		N/A
	Basic insulation on printed boards tested according to clause 14		N/A
	Distances subjected to both sinusoidal voltage as non-sinusoidal pulses not less than value in Table 16		N/A
	Creepage distances not less than minimum clearance		N/A
16 (-)	Conductive accessible parts in compliance with applicable parts of IEC 60598-1	No values are specified for working voltage below 60VDC as the electric strength test voltage of 500V is considered sufficient.	N/A

<b>17 (17)</b>	<b>SCREWS, CURRENT-CARRYING PARTS AND CONNECTIONS</b>		—
----------------	---	--	---



EN 62031			
Clause	Requirement + Test	Result - Remark	Verdict
	Cl. 17 refer to Cl. 17 of IEC 61347-1 which refer to Cl. 4.11 and 4.12 of IEC 60598-1 (clause numbers between parentheses refer to IEC 60598-1)		P
<b>(4.11)</b>	<b>Electrical connections</b>		P
(4.11.1)	Contact pressure		P
(4.11.2)	Screws:		N/A
	- self-tapping screws		N/A
	- thread-cutting screws		N/A
(4.11.3)	Screw locking:		N/A
	- spring washer		N/A
	- rivets		N/A
(4.11.4)	Material of current-carrying parts		P
(4.11.5)	No contact to wood or mounting surface		P
(4.11.6)	Electro-mechanical contact systems		N/A
<b>(4.12)</b>	<b>Mechanical connections and glands</b>		N/A
(4.12.1)	Screws not made of soft metal		N/A
	Screws of insulating material		N/A
	Torque test: torque (Nm); part :		N/A
(4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
(4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm) :		N/A
	- lampholder; torque (Nm) :		N/A
	- push-button switches; torque 0,8 Nm :		N/A
(4.12.5)	Screwed glands; force (Nm) :		N/A

<b>18 (18)</b>	<b>RESISTANCE TO HEAT, FIRE AND TRACKING</b>		—
- (18.1)	Ball-pressure test :	See Test Table 18 (18.1)	N/A
- (18.3)	Glow-wire test (650°C) :	See Test Table 18 (18.3)	N/A
- (18.4)	Needle-flame test (10 s) :	See Test Table 18 (18.4)	N/A
- (18.5)	Proof tracking test :	See Test Table 18 (18.5)	N/A

<b>19 (19)</b>	<b>RESISTANCE TO CORROSION</b>		—
	- test according 4.18.1 of IEC 60598-1		N/A
	- adequate varnish on the outer surface		N/A


<b>20</b>	<b>INFORMATION FOR LUMINAIRE DESIGN</b>		—
	Information in Annex D (informative)		—

**EN 62031**


Clause	Requirement + Test	Result - Remark	Verdict
<b>21</b>	<b>HEAT MANAGEMENT</b>		—
<b>21.1</b>	<b>General</b>		N/A
	Exchangeability is safeguarded by cap or base		N/A
<b>21.2</b>	<b>Heat-conducting foil and paste</b>		N/A
	Heat-conducting foil delivered with the module if necessary		N/A
<b>22</b>	<b>PHOTOBIOLOGICAL SAFETY</b>		—
<b>22.1</b>	<b>UV radiation</b>		N/A
	Luminous radiation not exceed 2mW/klm		N/A
<b>22.2</b>	<b>Blue light hazard</b>		P
	Assessed according to IEC TR 62778		P
<b>22.3</b>	<b>Infrared radiation</b>		N/A
	Requirements for infrared radiation when required		N/A
<b>A</b>	<b>ANNEX A - TESTS</b>		—
	All tests performed in accordance with the advice given in Annex H of IEC 61347-1, if applicable		P
<b>ANNEX 1</b>	<b>SELV-operated LED modules</b>		—
	Requirements not applicable to the evaluated product.		N/A

**Appendix 1**  
**Photo documentation**


**EUT Photo 1**

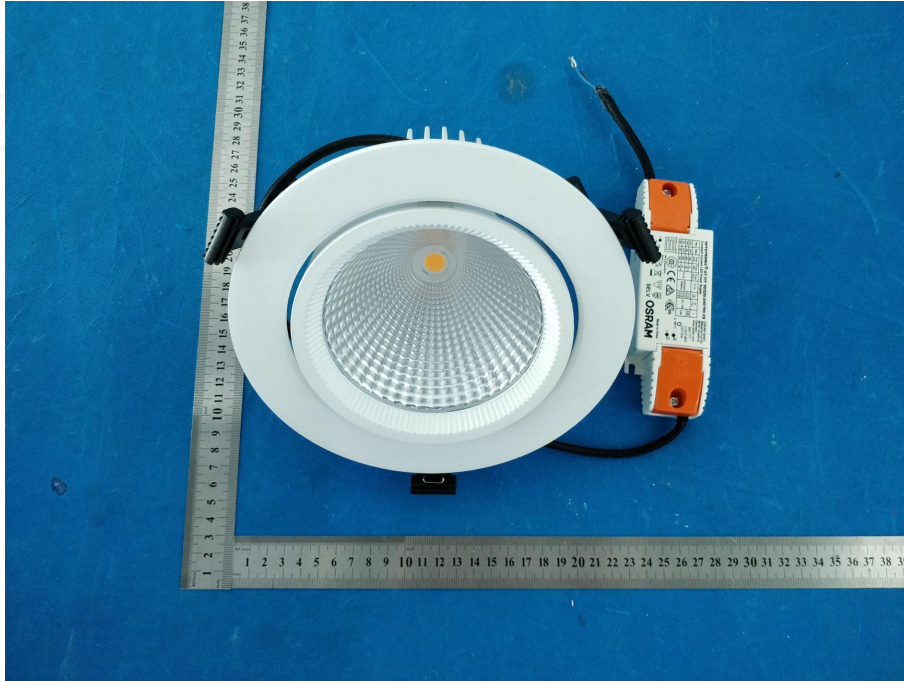


**EUT Photo 2**

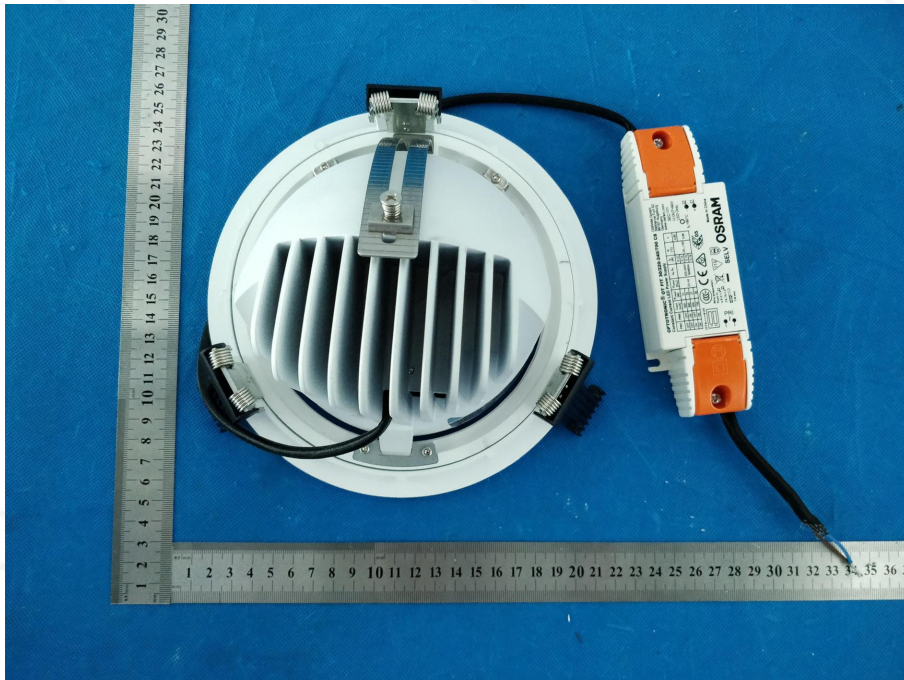


EUT Photo 3

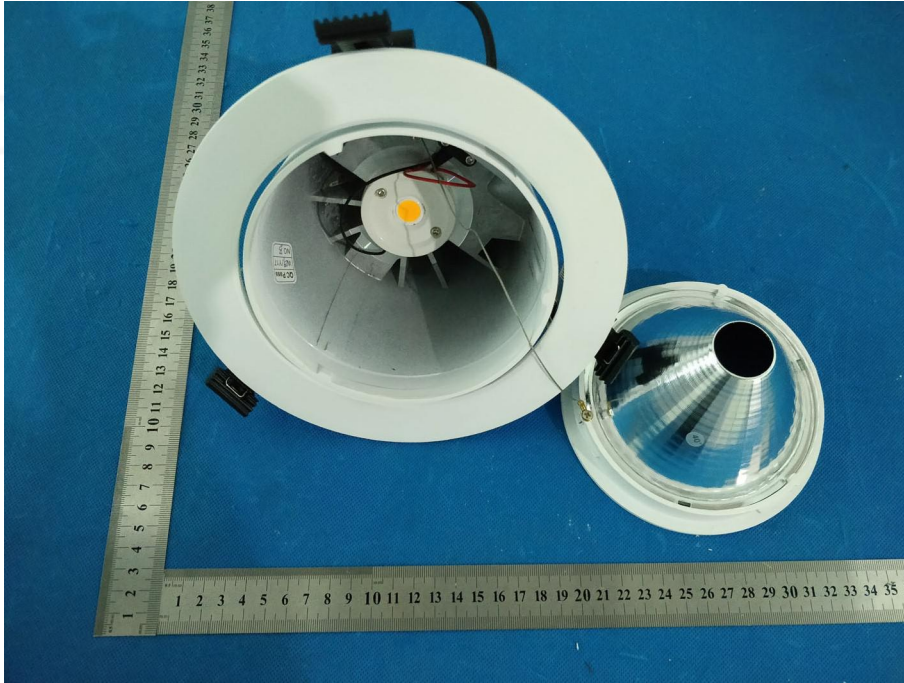

EUT Photo 4

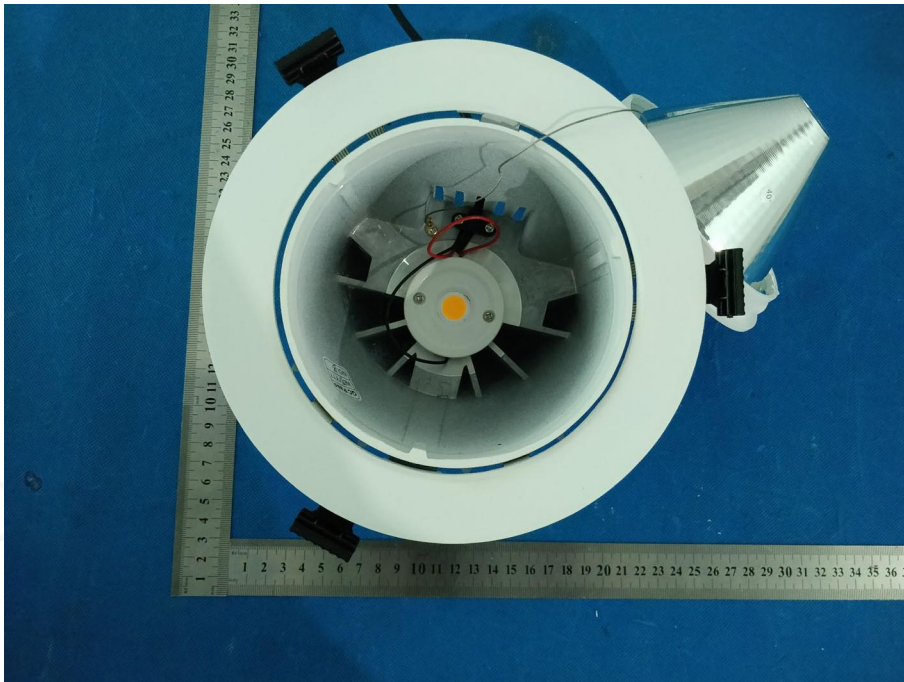

EUT Photo 5

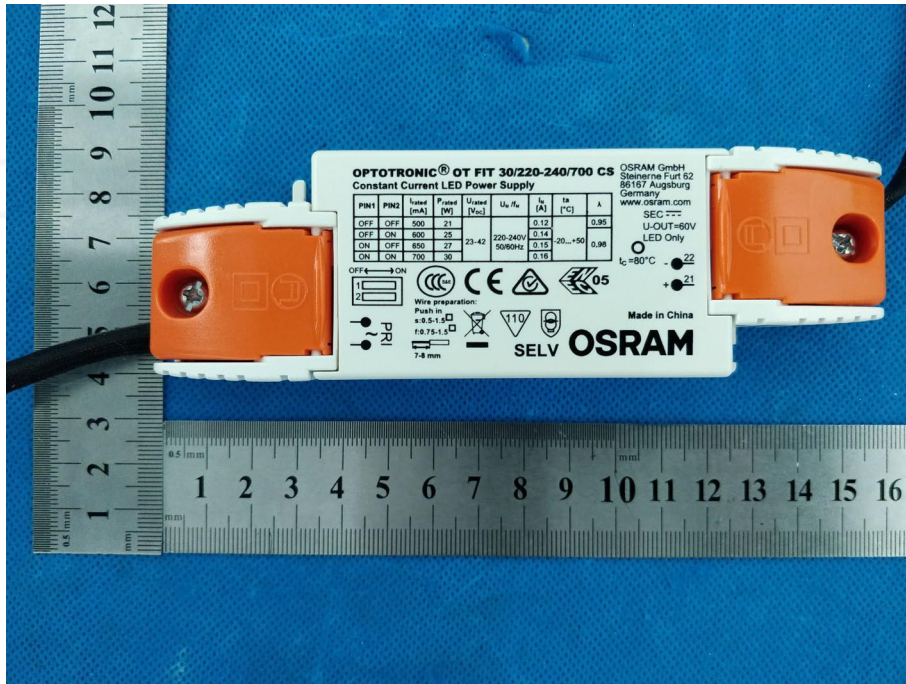

\*\*\*\*\* END OF REPORT \*\*\*\*\*